


CURVE NO. 6XL4AL-2

TESTS ON P.O. NO. 50174 A B B

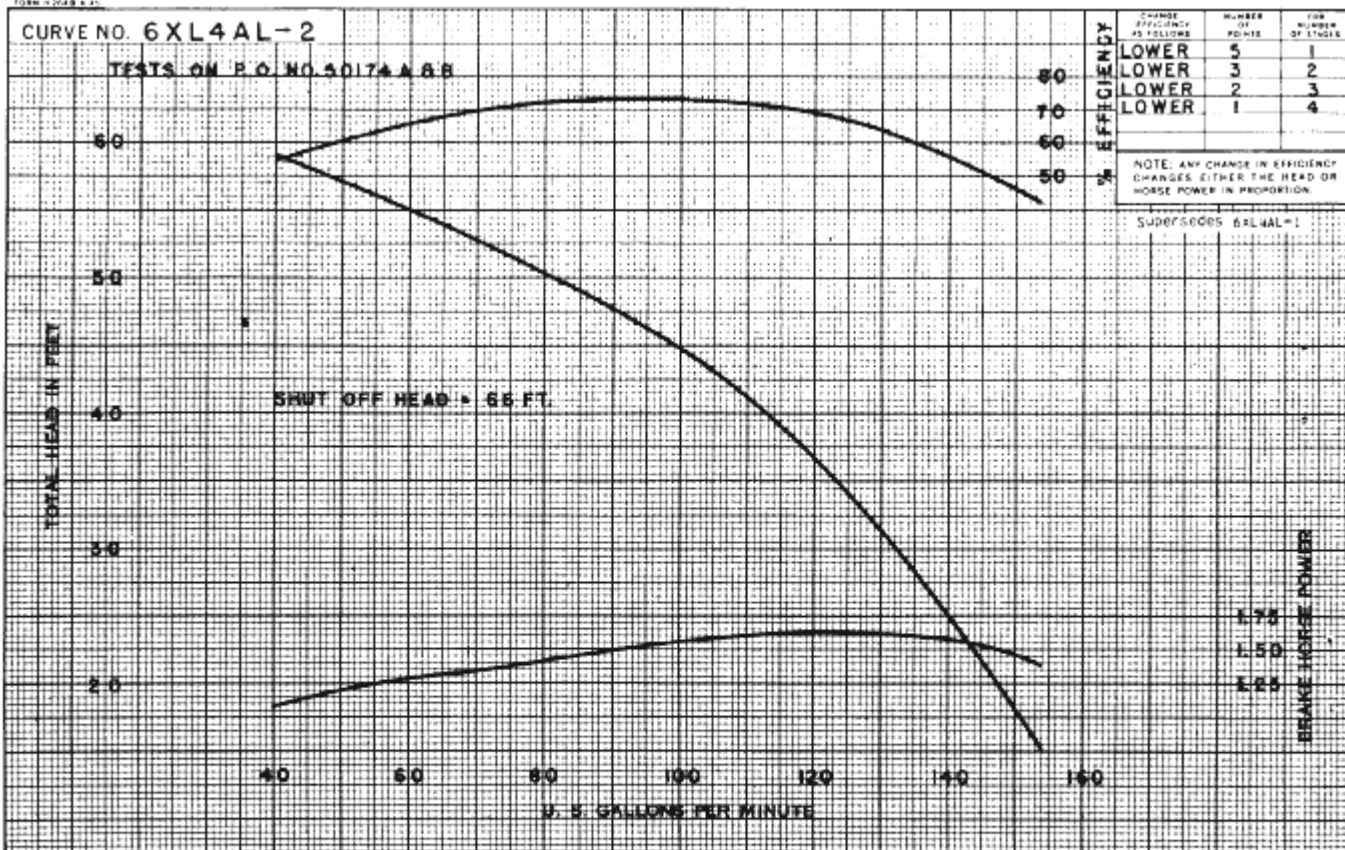

HYDRAULIC PERFORMANCE is contingent on the well furnishing the pump with the specified amount of clear, fresh, non-aerated water at a temperature of not to exceed 85 degrees Fahrenheit.

**FAIRBANKS, MORSE & CO.**

FAIRBANKS-MORSE BUILDING  
CHICAGO 3, ILLINOIS

2-1-50

LABORATORY PERFORMANCE **PL**  
PER STAGE 6XLC DEEP WELL TURBINE  
PUMP OPERATED AT 3500 R. P. M.  
FIELD LOSS MUST BE DEDUCTED